


• PART NUMBER SHOWN ARE
FOR 3/4" METER ASSEMBLY

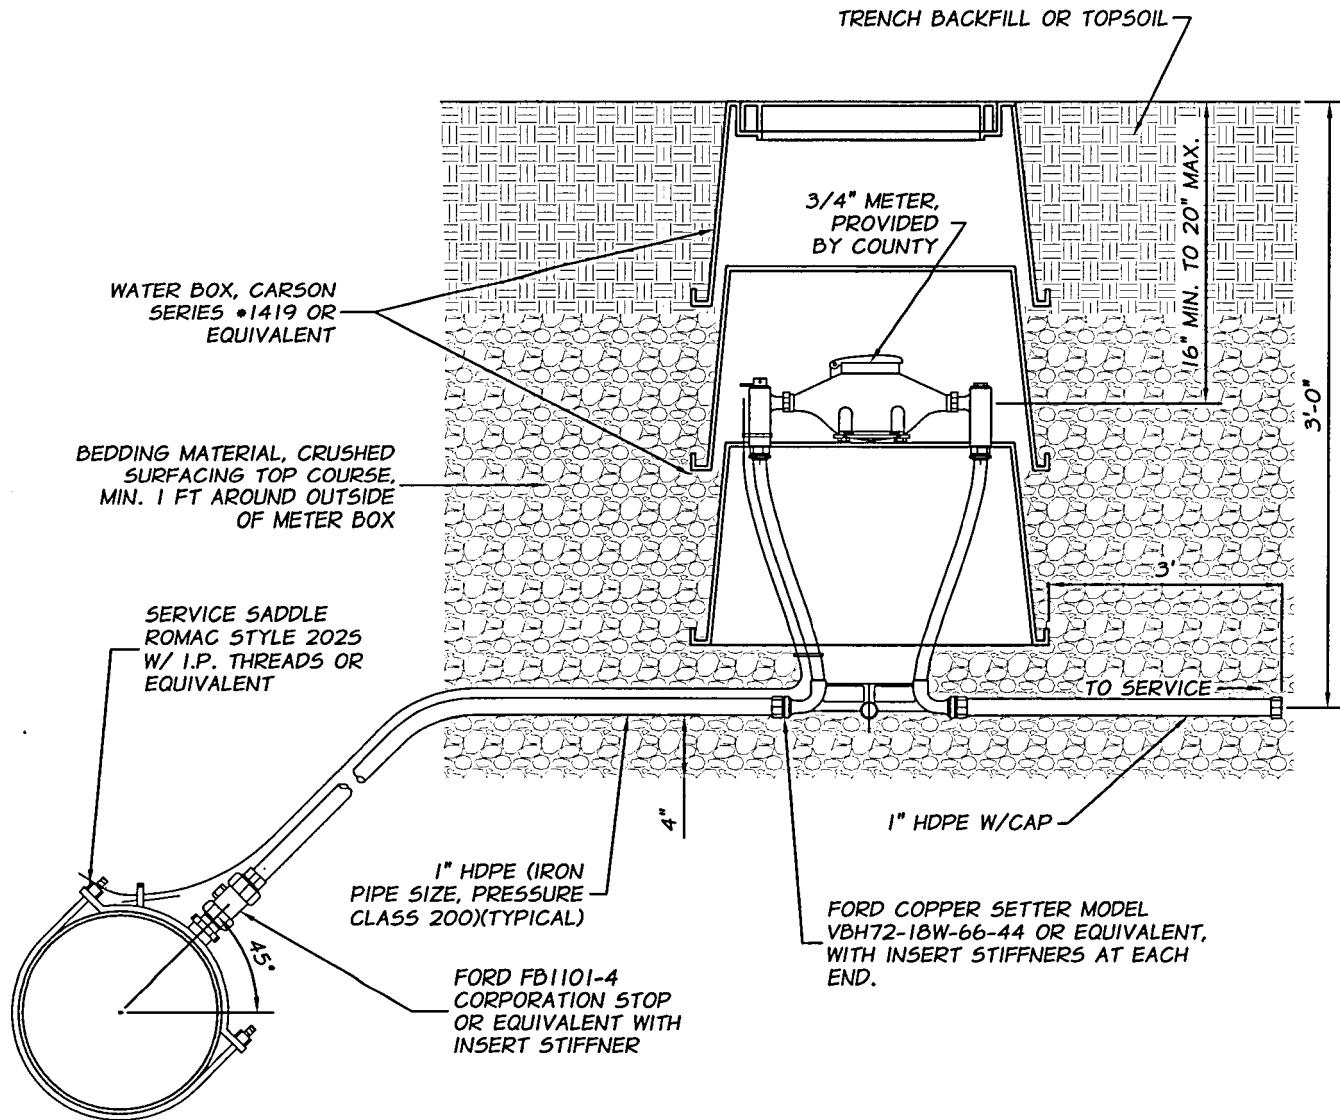

CROSS SECTION
NTS

NOTES:

- 1) BOX SHALL BE LOCATED 2' TO 3' BEHIND CURB OR SIDEWALK.
- 2) CONNECT TRACER WIRE TO MAINLINE TRACER WIRE WITH SPLIT BOLT OR SIMILAR CONNECTOR AND TO SETTER WITH NYLON ZIP-TIES. TAPE TO SERVICE LINE AT 6' INTERVALS.
- 3) SERVICE SADDLES SHALL BE A MINIMUM OF 24" FROM BOTH THE BACK OF THE BELL AND THE SPIGOT INSERTION LINE. SERVICE SADDLES SHALL ALSO BE AT LEAST 18" APART WHEN SERVICES ARE ON OPPOSITE SIDES OF THE MAINLINE, AND 36" APART WHEN ON THE SAME SIDE OF THE MAINLINE.

WATER SERVICE DETAIL



APPROVED BY:		<i>J.P. Stumpf</i>	DATE: <u>1/28/11</u>
Utilities Manager			
REVISION:	DESCRIPTION:	DATE:	
K.P.	STANDARD REVIEW	02-26-03	
J.M.	STANDARD REVIEW	06-09-09	
J.M.	ADDED NOTES, AND MODIFIED DIMENSION	01-26-11	

STANDARD PLAN	
W-1	
SHEET 1 OF 1	
FILE NAME: Q:\STANDARDS\WATER\W1.DWG	