


NOTES:

1. INSTALL SEWER SADDLE WITH GASKET AND STAINLESS STEEL CLAMPS FOR CONNECTION TO EXISTING SEWERS. INSTALL WYE OR TEE SEWER FITTING WITH GASKETS FOR NEW SEWER INSTALLATIONS.
2. MARK LOCATION OF SEWER STUB IN ACCORDANCE WITH CONTRACTING AGENCY REQUIREMENTS.
3. MINIMUM SLOPES SHOWN ARE FOR SIDE SEWERS WITH SEPTIC TANKS AND ARE FOR THE SECTION OF SIDE SEWER BETWEEN THE SEWER MAIN AND THE SEPTIC TANK. MINIMUM SLOPES FOR 4" THROUGH 6" DIAMETER SIDE SEWERS BETWEEN THE SEPTIC TANK AND THE HOUSE SHALL BE 2%, EXCEPT WHEN APPROVED BY THE COUNTY, AND WHERE IT IS IMPRACTICAL TO OBTAIN A SLOPE OF 2%, THE MINIMUM SLOPE FOR 6" DIAMETER SIDE SEWERS MAY BE REDUCED TO 1%.
4. FOR SIDE SEWERS WITHOUT SEPTIC TANKS, THE MINIMUM SLOPE SHALL BE 2% FOR 4" THROUGH 6" DIAMETER SIDE SEWERS, EXCEPT WHEN APPROVED BY THE COUNTY, AND WHERE IT IS IMPRACTICAL TO OBTAIN A SLOPE OF 2%, THE MINIMUM SLOPE FOR 6" DIAMETER SIDE SEWERS MAY BE REDUCED TO 1%.



SIDE SEWER

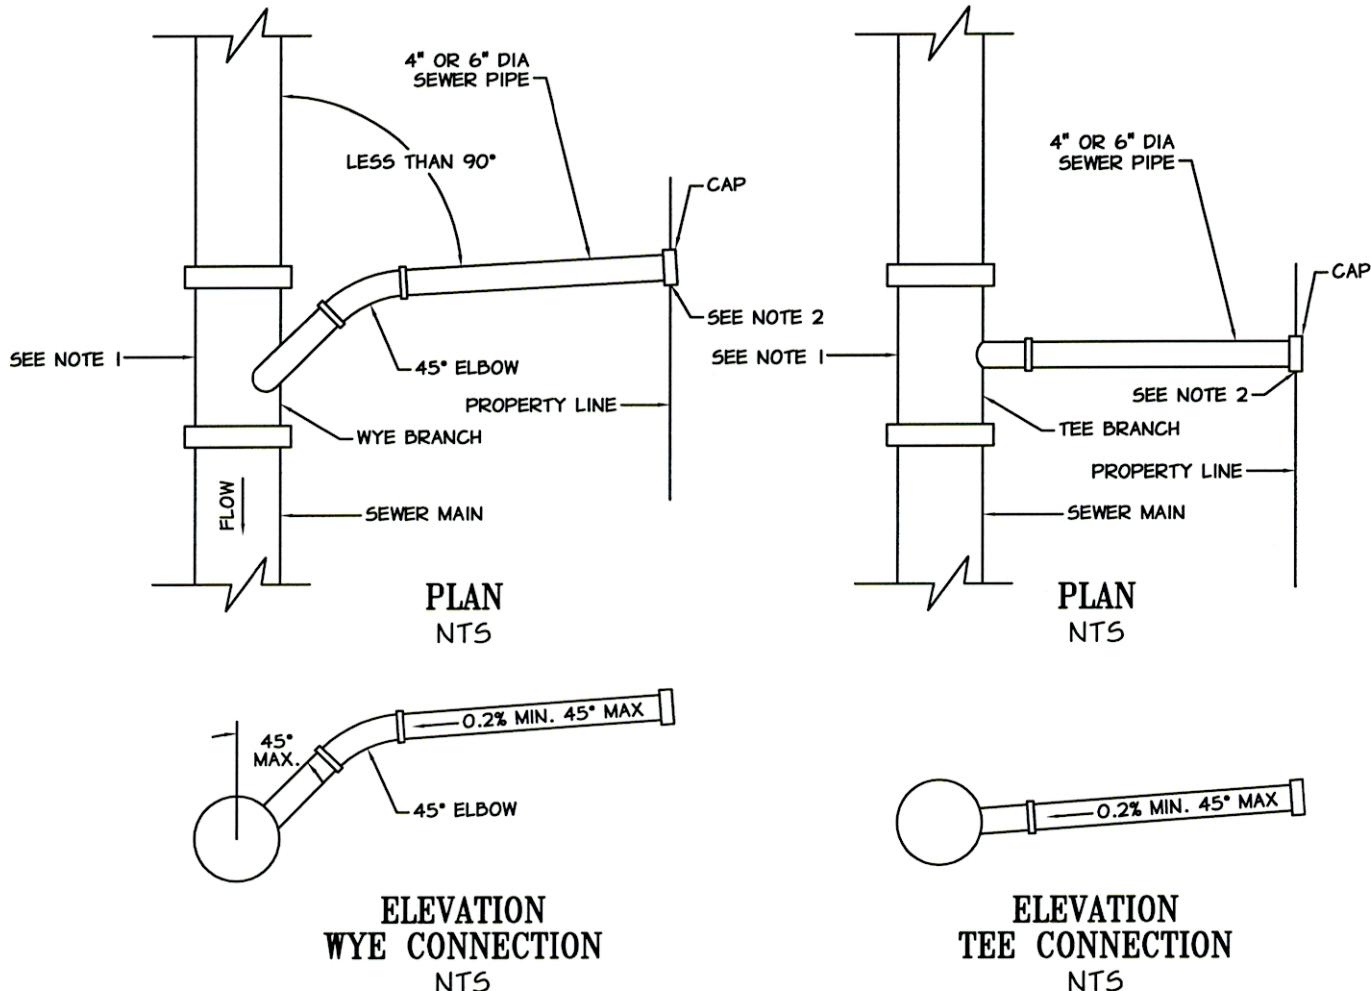

APPROVED BY:		<i>Jr. Sturby</i>	DATE:
Utilities Manager:		<i>9/12/06</i>	
REVISION:	DESCRIPTION:	DATE:	

SEWER PLAN  
**SS-5**  
SHEET 1 OF 1  
FILE NAME: