


FIBERGLASS OR POLETHYLENE SEPTIC TANK

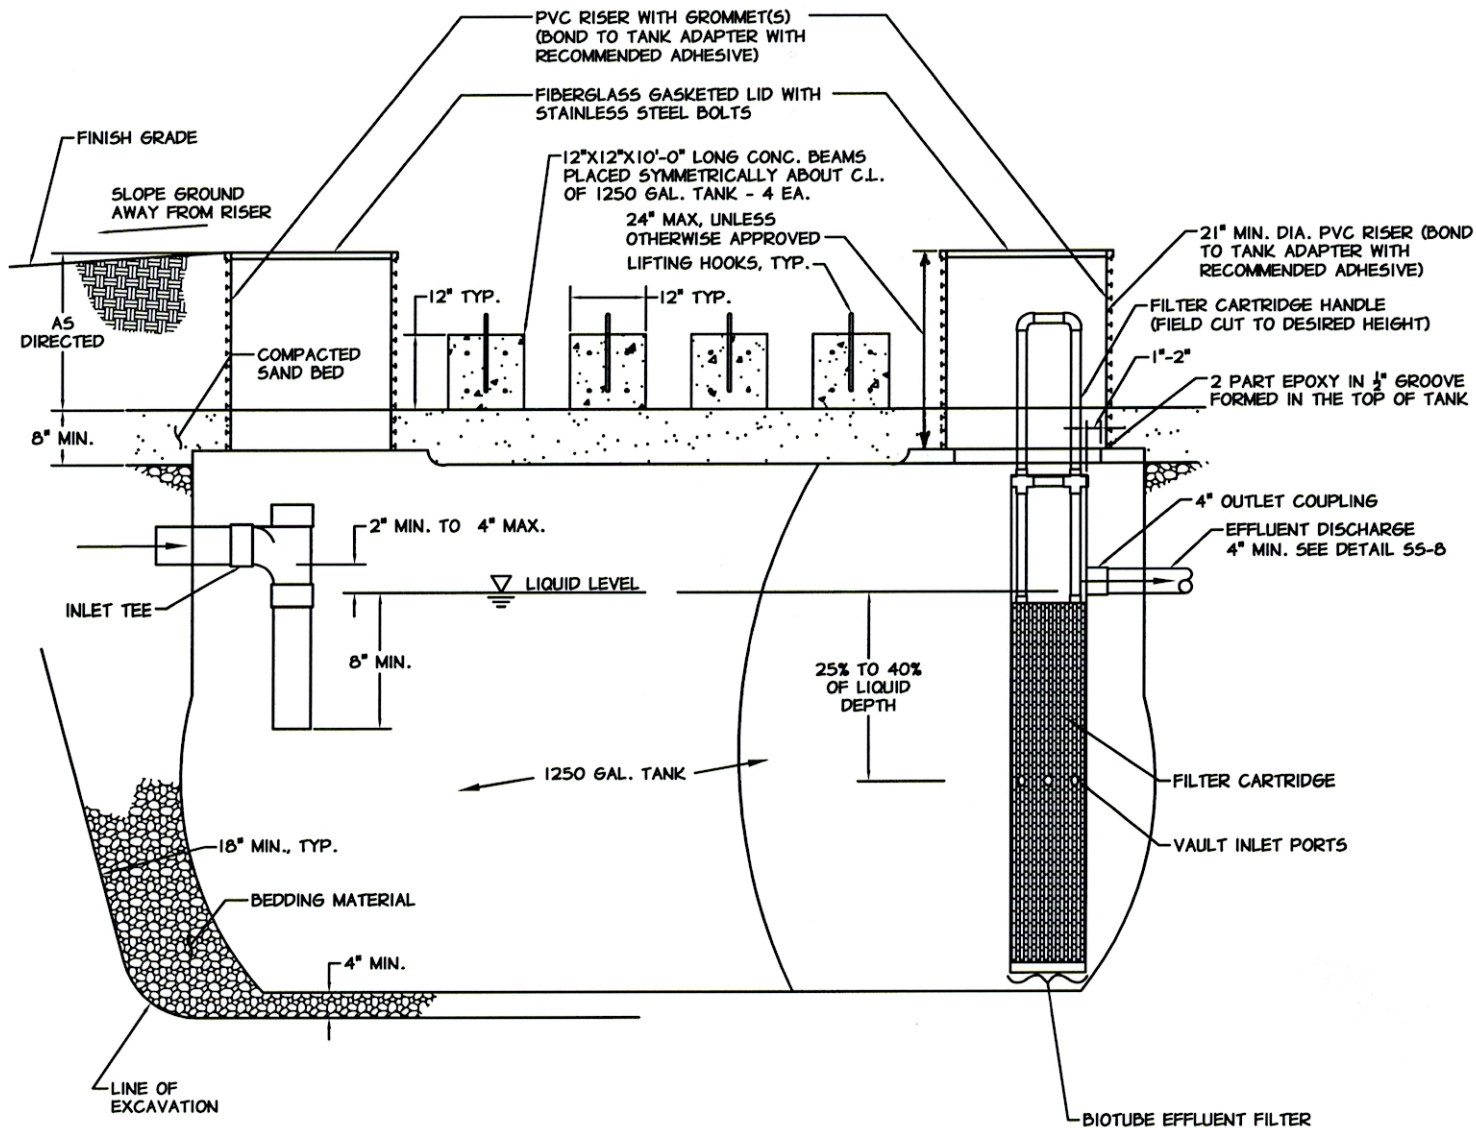

APPROVED BY:

for Strong
Utilities Manager

9/12/06

DATE:

REVISION:

DESCRIPTION:

DATE:

SEWER PLAN

SS-7

SHEET 1 OF 1

FILE NAME: