



Yakima Health District Media Release

For immediate release: December 11, 2021


Contact: Stephanie Badillo-Sanchez, Communications Specialist
Selah Public Works

509-941-7364
509-698-7365

Boil Water Advisory No Longer in Effect for Majority of City of Selah

Yakima, WA- The City of Selah worked with Washington State Department of Health (WA DOH) to lift the boil water advisory that has been set in place since December 10, 2021 for the majority of Selah.

City of Selah and WA DOH have completed their inspections and water sampling and have isolated the source of *E. coli* contamination in the public water system. The area that will continue to be under a boil water advisory is south of Southern Ave and west of 5th Ave, which includes roads South 7th St, Harris Ave, Lacey and Terrace Drive (highlighted in yellow below). This area will continue to be tested and monitored. The cause of the contamination is being investigated. All impacted households in the containment area have been notified directly.

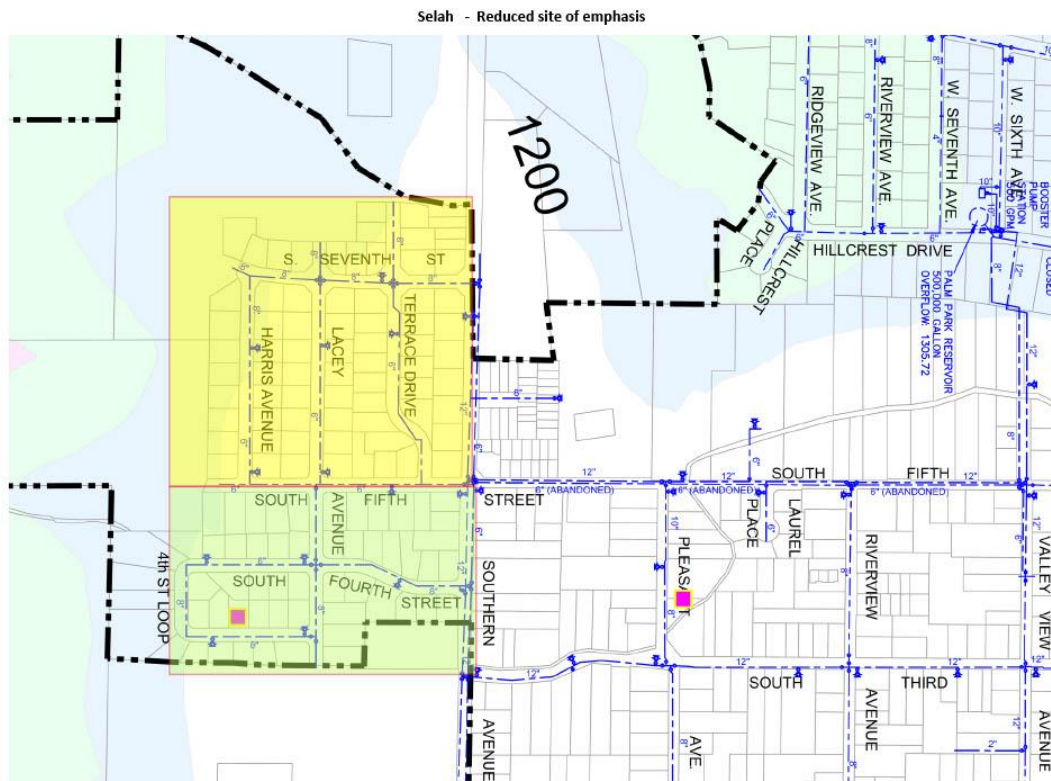



Yakima Health District

The City of Selah and Washington State Department of Health confirmed the safety of the water throughout the city by:

- Isolating the contaminated area of the water system from the rest of the city's water system
- Flushing the containment area,
- Chlorinating and flushing the water system, and
- Extensive testing was throughout the entire water system.

Additional Information:

[CDC: E. Coli Symptoms](#)

[CDC: E. Coli Questions & Answers](#)

###